

Christchurch City Council
SUPPLEMENTARY ATTACHMENTS UNDER SEPARATE
COVER

Date: Thursday 9 May 2019
Time: 9.30am
Venue: Council Chambers, Civic Offices,
53 Hereford Street, Christchurch


TABLE OF CONTENTS


PAGE

39 Water Supply Improvement Programme – update


Upated attachments to this report are available:

D.	Status of Wells - updated 7 May 2019	3
E.	Chlorination by Pumpstation to September - updated 7 May 2019	4
F.	Overview pie charts, May, July and September - updated 7 May 2019	5

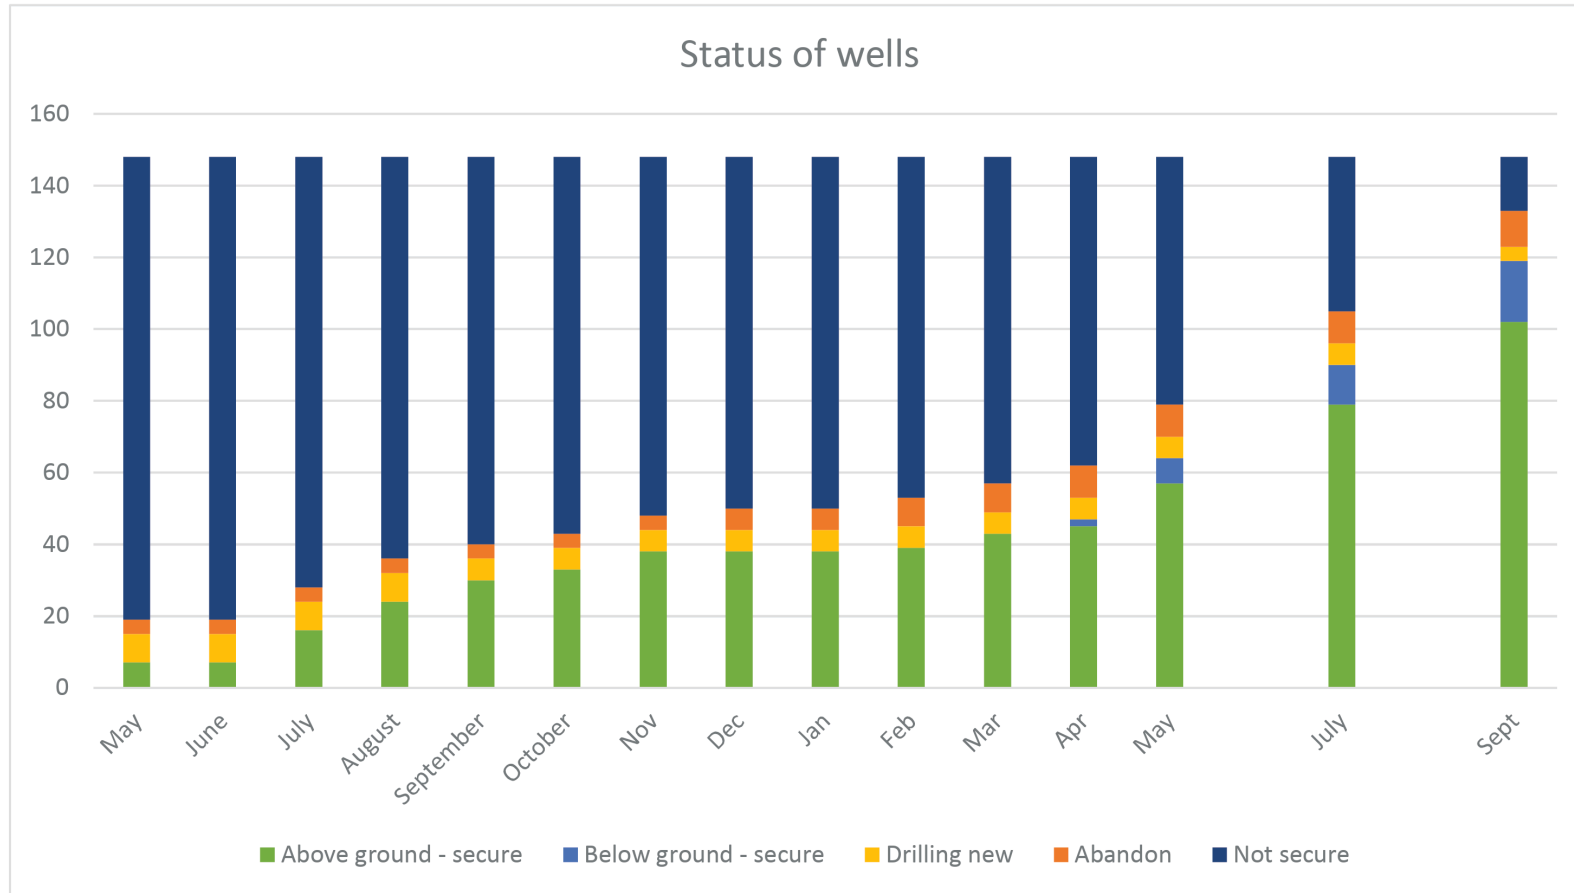


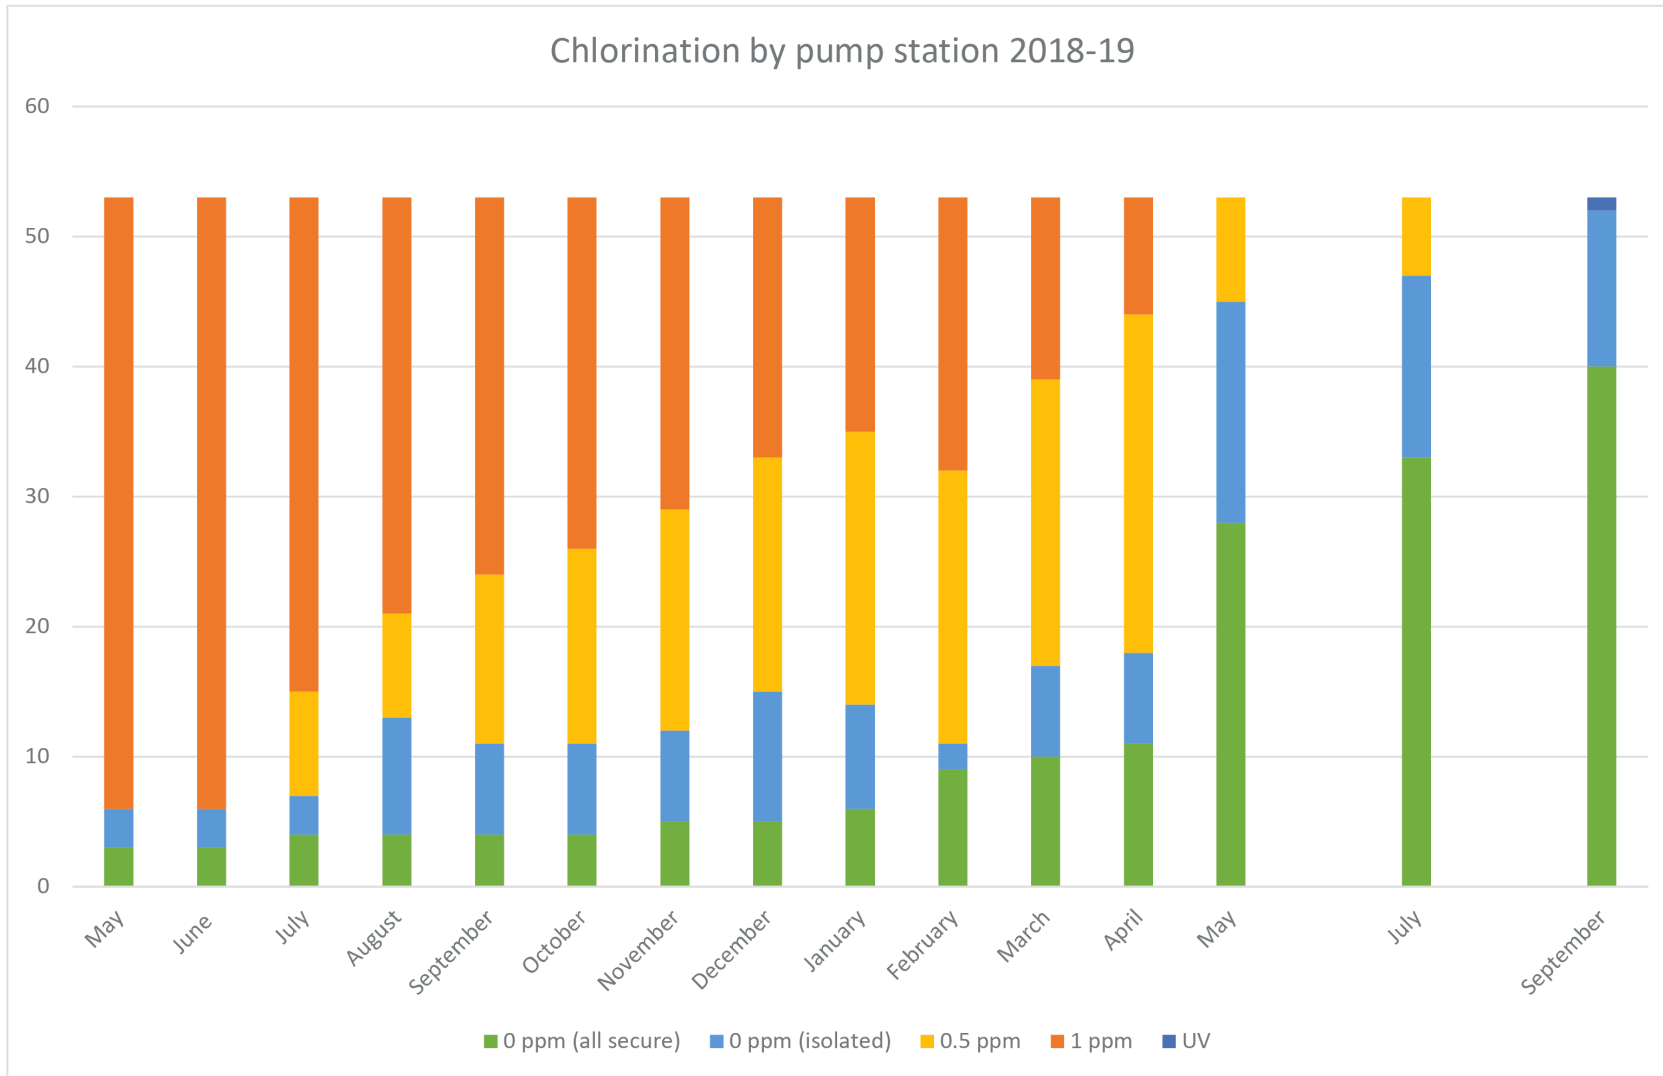


Expected status of wells May 2019

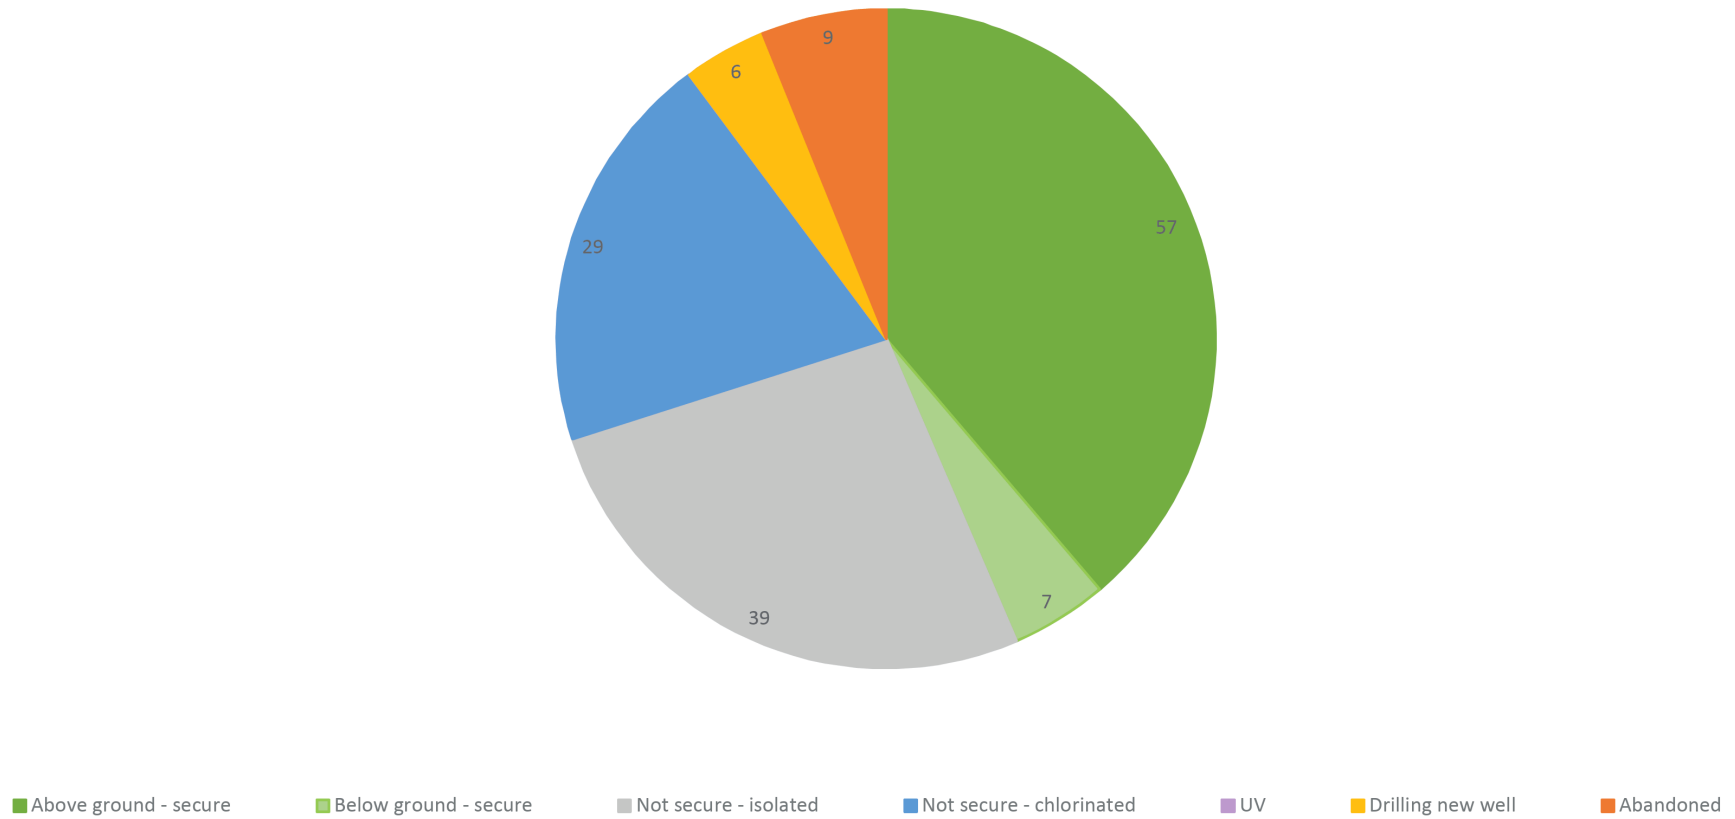

Expected status of wells July 2019

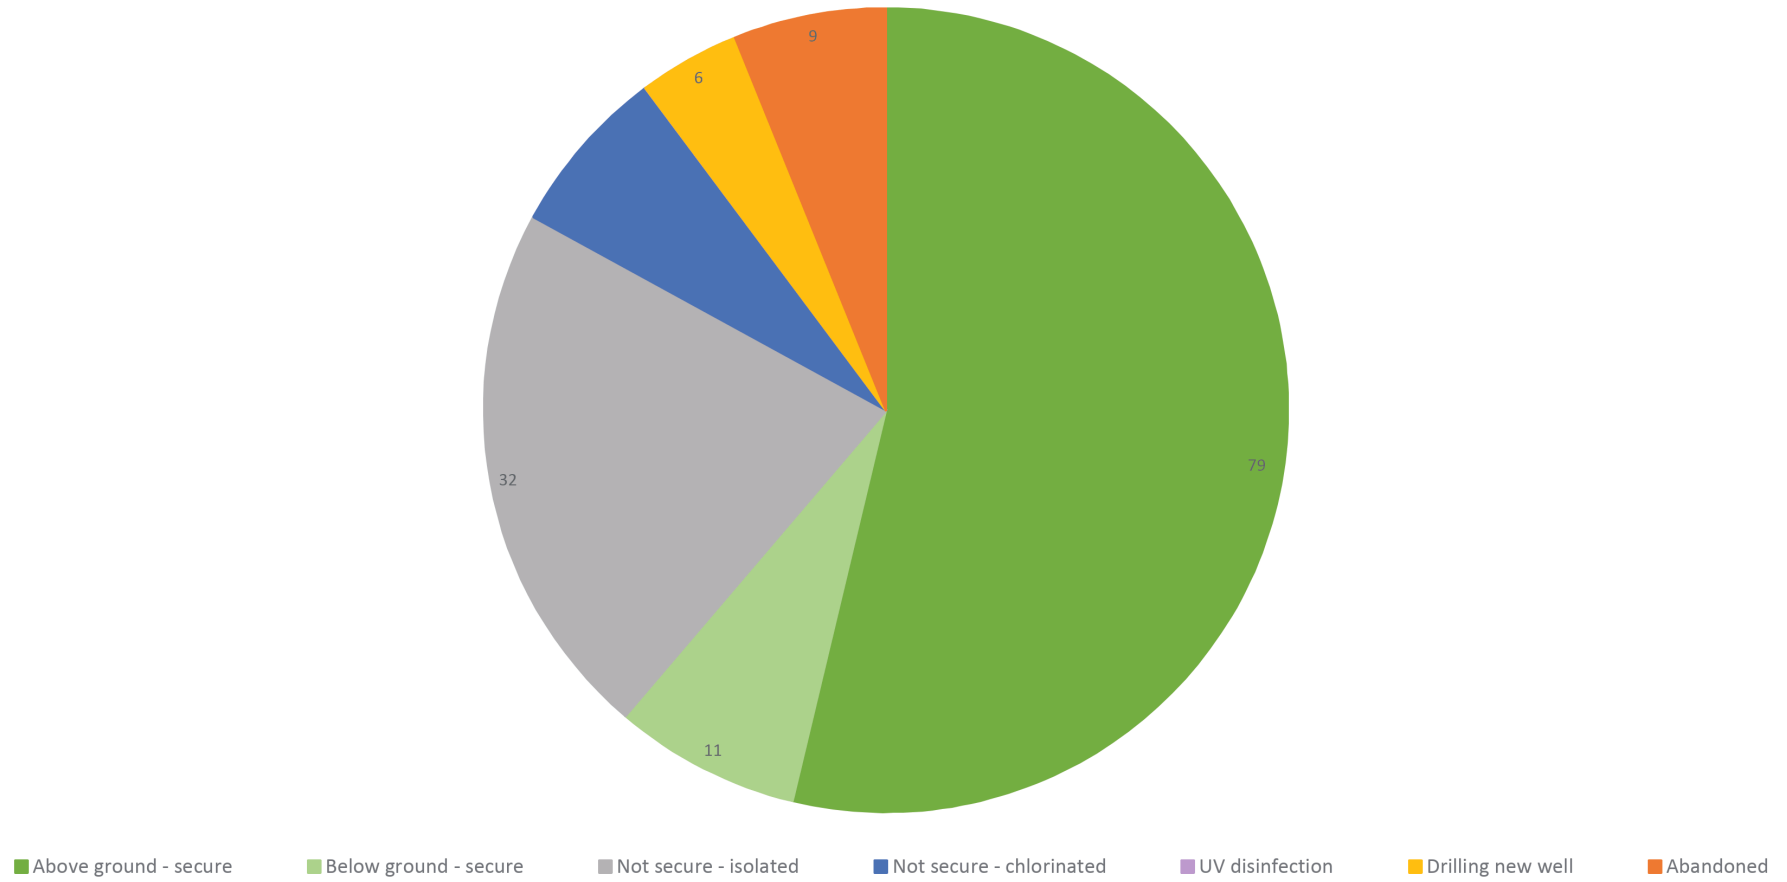

Expected status of wells September 2019

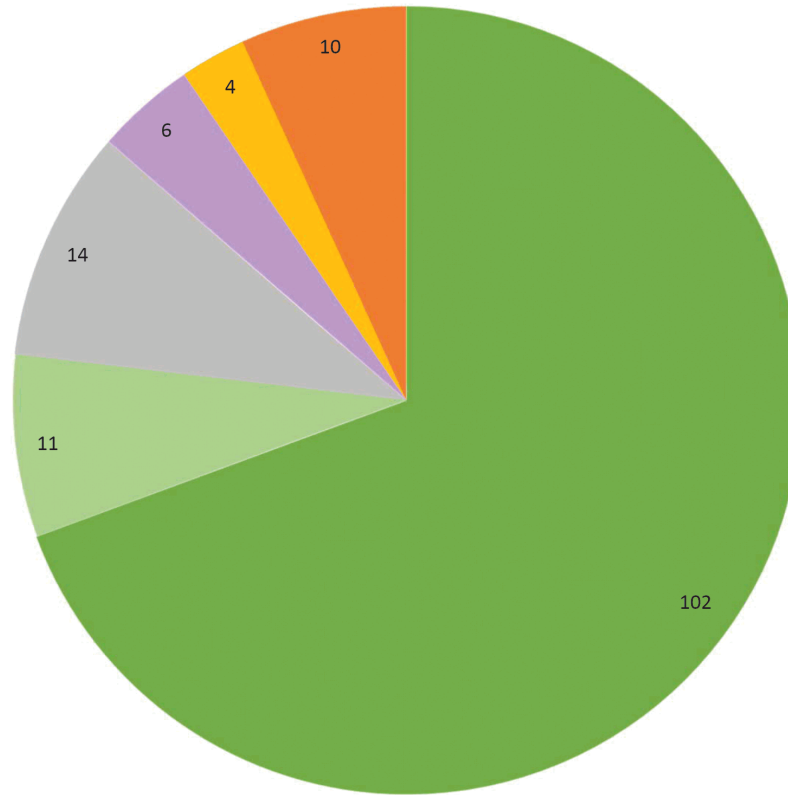

■ Above ground - secure ■ Below ground - secure ■ Not secure - isolated ■ Not secure - chlorinated ■ UV disinfection ■ Drilling new well ■ Abandoned

